

GENERAL NOTES:

1. DUCT AND PIPE SUPPORTS TO BE SPACED SUFFICIENTLY FROM PARTITION LINE TO ALLOW ACCESS FOR INSTALLATION AND SEALING.
2. THICKNESS OF STEEL SLEEVE TO BE SUFFICIENT TO SUPPORT MORTAR ABOVE. MINIMUM THICKNESS 1/16" INCH.

702
1

MULTIPLE PIPE/DUCT PENETRATION ACCOUSTIC SEALING

NOT TO SCALE

PROJECT:

HM 78 A-B

ARCHITECT OF RECORD:

S.M. BERGER ARCHITECTURE, P.C.

P.O. BOX 222113
GREAT NECK, NEW YORK 11022 TEL: 516. 773. 7365

EXECUTIVE ARCHITECT:

SLCE ARCHITECTS, LLP

1309 MIDCROWAY
NEW YORK, NY 10018 TEL: 212. 979. 8400

STRUCTURAL ENGINEER:

WSP CANTOR SEINUK

228 EAST 40TH STREET
NEW YORK, NY 10017 TEL: 212. 687. 9888

M.E.P ENGINEER:

WSP FLACK + KURTZ

512 SEVENTH AVENUE
NEW YORK, NY 10018 TEL: 212. 532. 9600

CODE CONSULTANT / EXPEDITING:

JEROME S. GILLMAN CONSULTING
ARCHITECTS, P.C.


40 WORTH STREET
NEW YORK, NY 10013
ZONING CONSULTANT: TEL: 212. 349. 9304

08/09/2017 ISSUED FOR DOB

No: Dots: Revision:

SCALE: NTS

KEY PLAN:

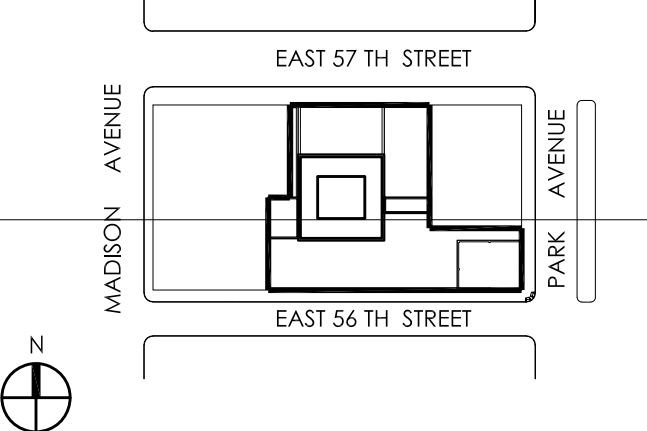

DRAWING TITLE:
MECHANICAL DETAIL SHEET 3

SEAL & SIGNATURE:

DATE:

PROJECT No:

DRAWN BY: DD

CHECKED BY: DD

DRAWING No:

CADSWITHE No:

M-702.00

M-702